

**Channel 1: DC to DC**

**Channel 2: DC to DC**

- Two Independent Channels with Full Isolation
- Zero and Span Potentiometers for Each Output
- Input and Output LoopTracker® LEDs
- Output Test/Manual Override for Each Channel
- Built-In I/O Power Supplies

**Applications**

- Monitor Two DC Signals
- Convert/Isolate Dual Output Transmitters

**Channel 1 DC Input Range**

Factory configured, please specify input type and range  
 Voltage: 0-10 mVDC to 0-100 VDC  
 Bipolar voltage: ±50 mVDC to ±10 VDC  
 Current: 0-1 mADC to 0-50 mADC, 4-20 mADC  
 Voltage input impedance: 200 kΩ minimum  
 Current input impedance: 50 Ω typical  
 Input com. mode rejection: 120 dB minimum  
 Current input voltage burden: 1.25 VDC max. at 20 mA  
 Input loop power supply: 15 VDC, ±10%, regulated, 25 mADC, may be connected for sinking or sourcing mA input

**Channel 2 DC Input Range**

Factory configured, please specify input type and range  
 Voltage: 0-10 mVDC to 0-100 VDC  
 Bipolar voltage: ±50 mVDC to ±10 VDC  
 Current: 0-1 mADC to 0-50 mADC, 4-20 mADC  
 Voltage input impedance: 200 kΩ minimum  
 Current input impedance: 50 Ω typical  
 Input com. mode rejection: 120 dB minimum  
 Current input voltage burden: 1.25 VDC max. at 20 mA  
 Input loop power supply: 15 VDC, ±10%, regulated, 25 mADC, may be connected for sinking or sourcing mA input

**LoopTracker**

Variable brightness LEDs indicate I/O levels for each channel

**Channel 1 and Channel 2 Output Ranges**

Factory configured, please specify for each output channel  
 Voltage: 0-1 VDC to 0-10 VDC, 10 mA max up to 20 VDC with M19, M29, M39  
 Bipolar voltage: ±1 VDC to ±10 VDC  
 Current: 0-1 mADC to 0-20 mADC, 4-20 mADC 20 V compliance, 1000 Ω at 20 mA

**Output Calibration**

Multi-turn zero and span potentiometers for each output channel ±15% of span adjustment range typical

**Output Ripple and Noise**

Less than 10 mV<sub>RMS</sub>

**Linearity**

Better than ±0.1% of span

**Ambient Temperature Range and Stability**

-10°C to +60°C operating ambient  
 Better than ±0.04% of span per °C stability

**Isolation**

Full 5-way, 1200 V<sub>RMS</sub> minimum

**Response Time**

70 milliseconds nominal

**Output Loop Power Supplies**

20 VDC nominal, regulated, 25 mADC for each output channel  
 May be selectively wired for sinking or sourcing mA output

**Output Test**

Front buttons set each output to test level when pressed  
 Each test level potentiometer adjustable 0-100% of span

**Installation Environment**

IP 40, requires installation in panel or enclosure with adequate ventilation  
 For use in Pollution Degree 2 Environment  
 Mount vertically (as shown in picture) to a 35 mm DIN rail allowing minimum 1" (25 mm) above and below housing vents for air circulation

**Power**

85-265 VAC, 50/60 Hz or 60-300 VDC, 6 W maximum  
 D versions: 9-30 VDC or 10-32 VAC 50/60 Hz, 6 W maximum



**Quick Link**  
[api-usa.com/2000](http://api-usa.com/2000)

**Free Factory I/O Setup!**

**Dimensions and Connectors**

1.78" W x 4.62" H x 4.81" D  
 45 mm W x 117 mm H x 122 mm D  
 Eight 4-terminal removable connectors, 14 AWG max wire size

**Description**

The APD 2000 DuoPak accepts two DC voltage or current inputs and provides two optically isolated DC voltage or current outputs that are linearly related to the inputs.

The input ranges and the output ranges for each channel are independent and can be specified as required. This provides an economical two channel solution in one device.

Typical applications include signal conversion, isolation, and redundancy (i.e. to prevent failure of the entire loop if one device fails), or a combination of these.

Each input signal is filtered, amplified, and then passed through an opto-coupler to the output stages. Full 5-way isolation (input 1, input 2, output 1, output 2, power) make this module useful for ground loop elimination, common mode signal rejection, and noise pickup reduction.

**I/O Sink/Source Versatility**

Standard on the APD 2000 are 15 VDC loop excitation supplies for each input channel and 20 VDC loop excitation supplies for each output channel. These power supplies can be selectively wired for sinking or sourcing allowing use with any combination of powered or unpowered milliamp I/O devices.

**How to Order**

Models are factory ranged. See I/O ranges above left.

Ranges and options for each channel must be specified on order

**Channel 1 input range**

**Channel 2 input range**

**Channel 1 output range**

**Channel 2 output range**

Model	Description	Power
APD 2000	DuoPak 2 channel DC-DC converter/	85-265 VAC, 50/60 Hz or 60-300 VDC
APD 2000 D	isolator/transmitter	9-30 VDC or 10-32 VAC

Sink or Source mA Output for Each Channel

Output LoopTracker LED for Each Channel

Adjustable Output Test Function for Each Channel

Zero and Span for Each Channel

Input LoopTracker LED for Each Channel

Custom I/O Ranges

Connect Sink or Source mA Input for Each Channel

Universal Power



Removable Plugs

See Wiring Diagrams on Next Page

**LoopTracker**

API exclusive features include four LoopTracker LEDs (green for each input, red for each output) that vary in intensity with changes in the process input and output signals.

These provide a quick visual picture of your process loop at all times and can greatly aid in saving time during initial startup and troubleshooting.

**Output Test**

An API exclusive feature includes output test buttons for each channel to provide a fixed output (independent of the input) when held depressed.

Terminals are also provided to operate the test functions remotely for each channel. This also allows use as a remote manual override to provide a temporary fixed output if desired.

The test output level for each channel is potentiometer adjustable from 0 to 100% of the output span. The output test greatly aids in saving time during initial startup and/or troubleshooting.

**Options and Accessories**

**Options—add to end of model number**

- R1** Channel 1 I/O reversal (i.e. 20-4 mA out)
- R2** Channel 2 I/O reversal (i.e. 20-4 mA out)
- R3** Channel 1 and channel 2 I/O reversal
- M19** Channel 1 high voltage output >10 V up to 20 V
- M29** Channel 2 high voltage output >10 V up to 20 V
- M39** Channel 1 and channel 2 high voltage output
- U** Conformal coating for moisture resistance

**Accessory—order as separate line item**

**API BP4** Spare removable 4 terminal plug, black

**Precautions**

WARNING! All wiring must be performed by a qualified electrician or instrumentation engineer. See diagram for terminal designations and wiring examples. Consult factory for assistance.

WARNING! Avoid shock hazards! Turn signal input, output, and power off before connecting or disconnecting wiring, or removing or installing module.

**Précautions**

ATTENTION! Tout le câblage doit être effectué par un électricien ou ingénieur en instrumentation qualifié. Voir le diagramme pour désignations des bornes et des exemples de câblage. Consulter l'usine pour assistance.

ATTENTION! Éviter les risques de choc! Fermez le signal d'entrée, le signal de sortie et l'alimentation électrique avant de connecter ou de déconnecter le câblage, ou de retirer ou d'installer le module.

API maintains a constant effort to upgrade and improve its products. Specifications are subject to change without notice. See [api-usa.com](http://api-usa.com) for latest product information. Consult factory for your specific requirements.

WARNING: This product can expose you to chemicals including nickel, which is known to the State of California to cause cancer or birth defects or other reproductive harm. For more information go to [www.P65Warnings.ca.gov](http://www.P65Warnings.ca.gov)

**Electrical Connections**

See wiring diagrams at right. Observe polarity. If the output does not function, check wiring and polarity.

\* Do not make any connections to unused terminals or use them as wiring junctions for external devices. This may cause permanent damage to the module!

**Outputs**

For milliamp ranges determine if your devices provide power to the current loop or if the loop must be powered by the APD module. Typical voltage may be 9-24 VDC at your device's terminals if it provides power to the loop. See note about terminating an unused mA output channel.

Device for Output Channel 1	Terminal	Terminal
Measuring/recording device accepts a voltage input.	3 (-)	4 (+)
Measuring/recording device has an unpowered or passive mA input. APD module provides the loop power.	3 (-)	4 (+20 V)
Measuring/recording device has a mA input and powers the current loop.	2 (-)	3 (+)
Device for Output Channel 2	Terminal	Terminal
Measuring/recording device accepts a voltage input.	7 (-)	8 (+)
Measuring/recording device has an unpowered or passive mA input. APD module provides the loop power.	7 (-)	8 (+20 V)
Measuring/recording device has a mA input and powers the current loop.	6 (-)	7 (+)

**Inputs, DC**

For milliamp ranges determine if your devices provide power to the current loop or if the loop must be powered by the APD module. Typical voltage may be 9-24 VDC at your device's terminals if it provides power to the loop.

DC Input Channel 1	Terminal	Terminal
Sensor or transmitter with voltage output.	17 (-)	19 (+)
Transmitter with a mA output that powers the current loop. Typically a 3 or 4-wire device.	17 (-)	19 (+)
Transmitter with an unpowered mA output. Typically a 2-wire device. APD module provides loop power.	19 (-)	18 (+15 V)
DC Input Channel 2	Terminal	Terminal
Sensor or transmitter with voltage output.	21 (-)	23 (+)
Transmitter with a mA output that powers the current loop. Typically a 3 or 4-wire device.	21 (-)	23 (+)
Transmitter with an unpowered mA output. Typically a 2-wire device. APD module provides loop power.	23 (-)	22 (+15 V)

**Module Power Terminals**


Check model/serial number label for module operating voltage to make sure it matches available power. The power supplies are fuse protected and the unit may be returned to API for fuse replacement.

When using DC power, either polarity is acceptable, but for consistency, wire positive (+) to terminal 25 and negative (-) to terminal 28.

**Mounting to a DIN Rail**

Install module vertically on a 35 mm DIN rail in a protective enclosure away from heat sources. Do not block air flow. Allow 1" (25 mm) above and below housing vents for air circulation.

1. Tilt front of module down and position the lower spring clips against the bottom edge of DIN rail.
2. Push front of module upward until upper mount snaps into place.

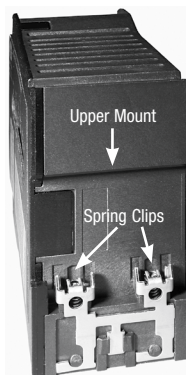

**Removal**

Avoid shock hazards! Turn signal input, output, and power off.

1. Push up on bottom back of module.
2. Tilt front of module downward to release upper mount from top edge of DIN rail.
3. The module can now be removed from the DIN rail.

**Calibration**

Input and output ranges are factory pre-configured (at 24°C ±1°C). Front-mounted Zero and Span potentiometers for each channel can be used to compensate for load and lead variations.

1. Apply power to the module and allow a minimum 30 minute warm up time.
2. Using an accurate calibration source, provide an input to the module equal to the minimum input required for the application.
3. Using an accurate measurement device for the output, adjust the Zero potentiometer for the exact minimum output desired. The Zero control should only be adjusted when the input signal is at its minimum. This will produce the corresponding minimum output signal. For example: 4 mA for a 4-20 mA output or -10 V for a ±10 V output.
4. Set the input at maximum, and then adjust the Span pot for the exact maximum output desired. The Span control should only be adjusted when the input signal is at its maximum. This will produce the corresponding maximum output signal. Example: for 4-20 mA output, the Span control will provide adjustment for the 20 mA or high end of the signal.
5. Repeat adjustments for both output channels for maximum accuracy.

**Output Test Function**

When the Test button is depressed it will drive the output with a known good signal that can be used as a diagnostic aid during initial start-up or troubleshooting. When released, the output will return to normal.

Each Test Cal. potentiometer is factory set to approximately 50% output. Each can be adjusted to set the test output from 0 to 100% of the output span. Press and hold the Test button and adjust the corresponding Test Cal. potentiometer for the desired output level.




They may optionally be externally wired for remote test operation or a manual override. See wiring diagram at right.

**Operation**




The APD 2000 accepts two independent DC voltage or current inputs and provides two independent and optically isolated DC voltage or current outputs that are linearly related to each input. Green LoopTracker® input LEDs provide a visual indication that each signal is being sensed by the input circuitry of the module. They also indicates the input signal strength by changing in intensity as the process changes from minimum to maximum. If an LED fails to illuminate, or fails to change in intensity as the process changes, check the module power or signal input wiring. Note that it may be difficult to see the LEDs under bright lighting conditions.

Two red LoopTracker output LEDs provide a visual indication that the output signals are functioning. They become brighter as the input and each corresponding output change from minimum to maximum.

For a current output the red LED will only light if the output loop current path is complete. For either current or voltage outputs, failure to illuminate or a failure to change in intensity as the process changes may indicate a problem with the module power or signal output wiring.

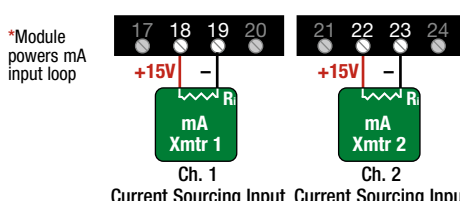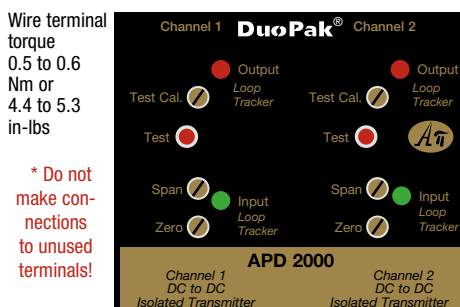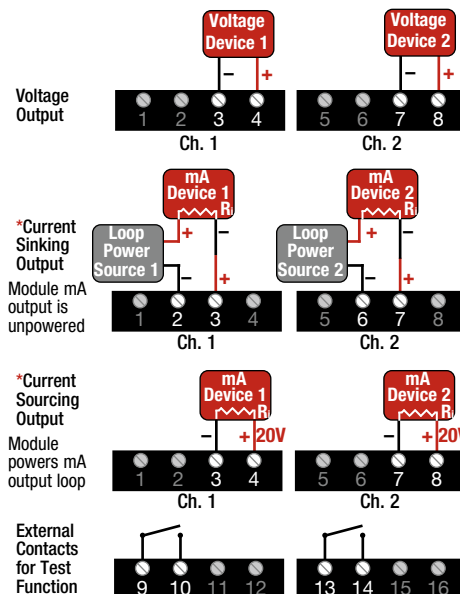

**\*Do not make connections to unused terminals!**

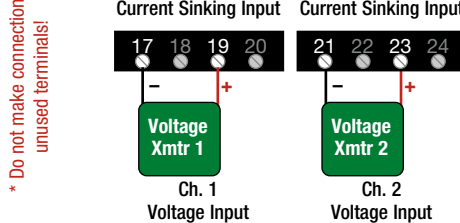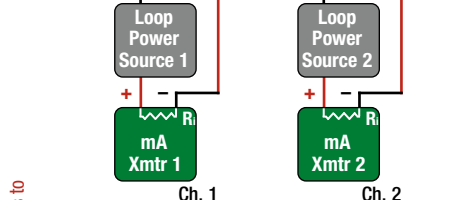

To maintain full isolation avoid combining power supplies in common with inputs, outputs, or unit power.

\* To avoid damage to the module, do not leave any unused mA inputs or outputs disconnected. Use a 1000 Ohm 1/2 Watt resistor across unused mA terminals.